


PARKEND | CABLE | NORCHARD

50V -ve batt upt 12
earth upt 11

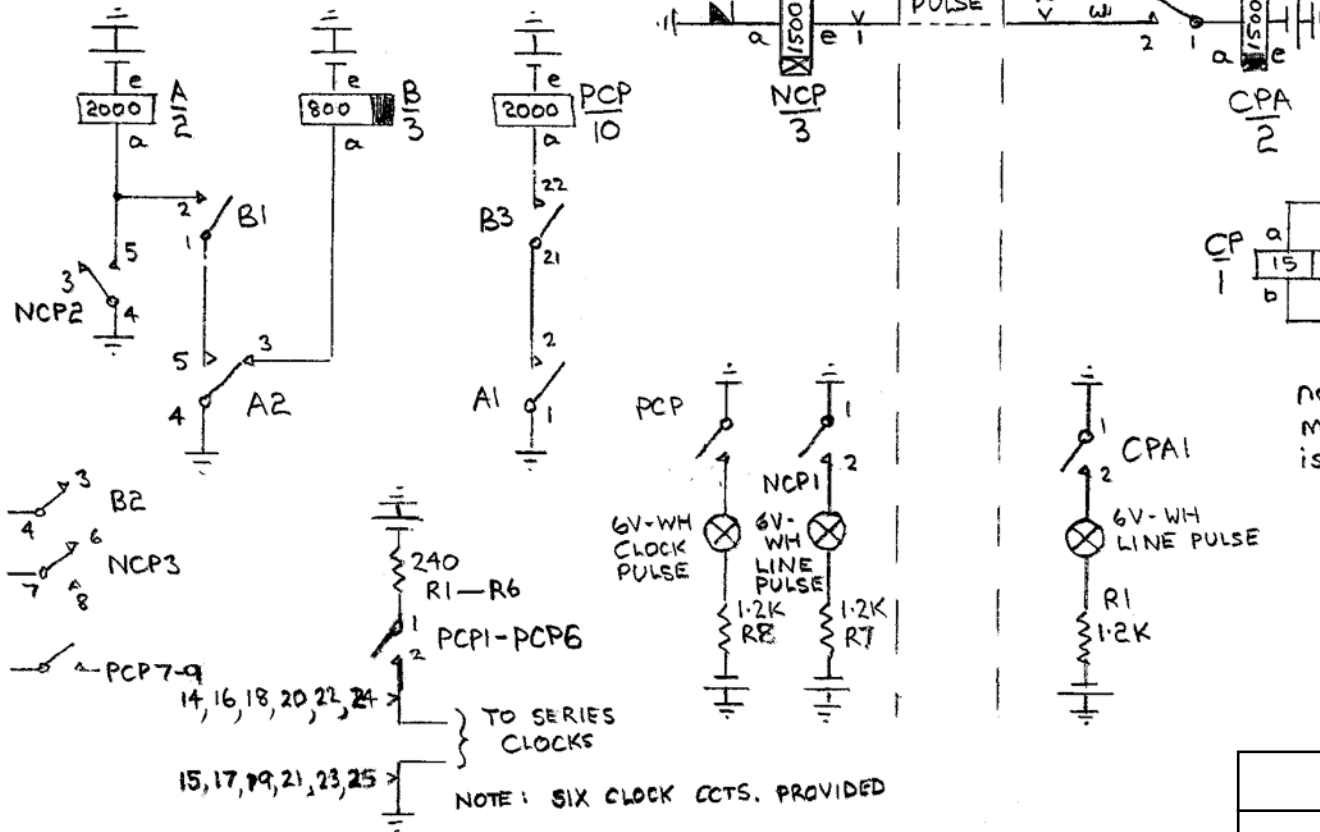

Note : The output clock pulse is always the length of the B Relay release lag no matter the length of the input pulse.

Parkend - Clock Relay Set		
DFR ex015b		
ISSUE A	30/01/2018	Opening Issue
Dean Forest Railway		

